


SPECIAL INLET 2', 3' AND 4' DEPTH

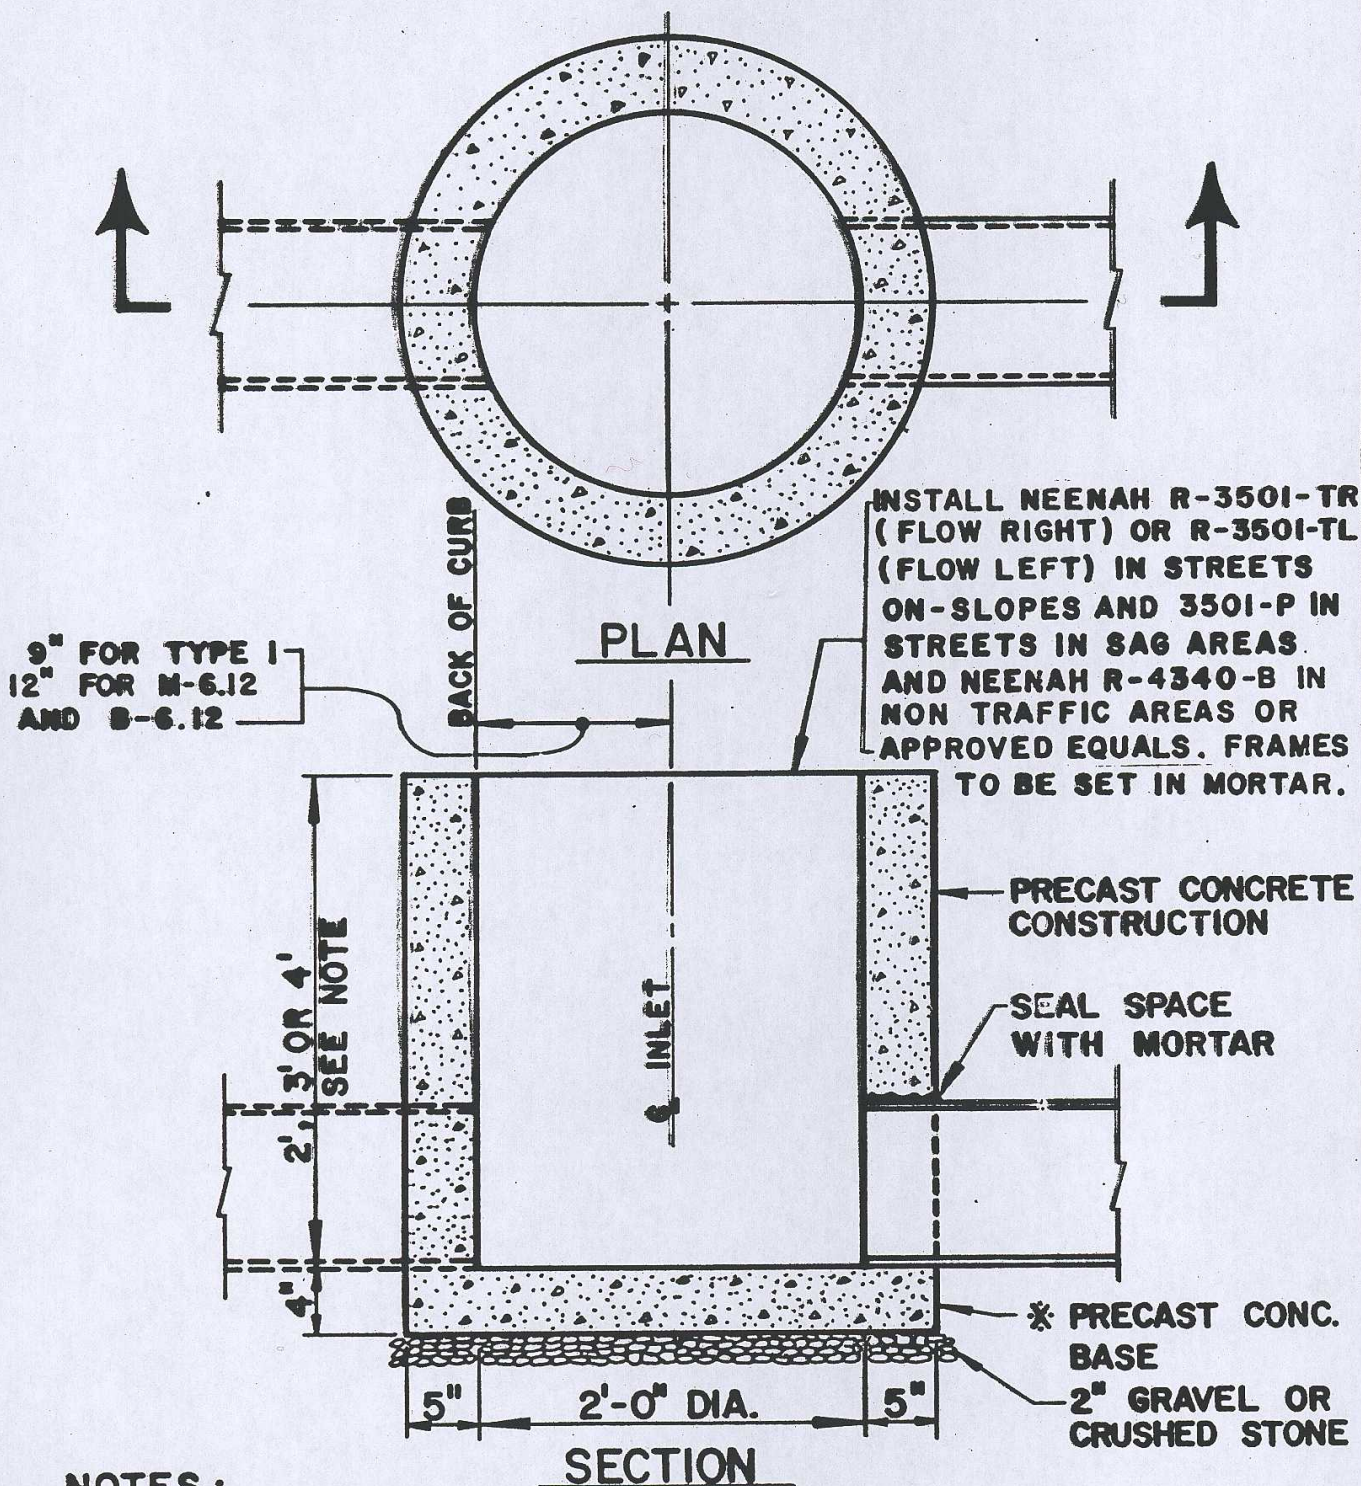

NOTES:

1. PIPE OPENINGS TO BE CAST INTO WALL.
2. * IT IS PREFERRED THAT PRECAST CONCRETE BASE BE CAST INTEGRAL WITH LOWEST WALL SECTION.
3. WHENEVER TWO INLETS ARE CONNECTED BY MORE THAN 20 FEET OF CONNECTION PIPE, THE INLET RECEIVING THE FLOW SHALL BE 3' OR 4'.